


$P_i = 24.50 \text{ kW}$
 $P_{nj} = \text{knj.pr Pp}$
 $P_{nj} = 0.5 \cdot 24.50 = 12.25 \text{ kW}$
 $I_n = 12.25 / (1.73 \cdot 400 \cdot 0.9) = 19.66 \text{ A}$

Kuadri Shperndarës KSHP-1U

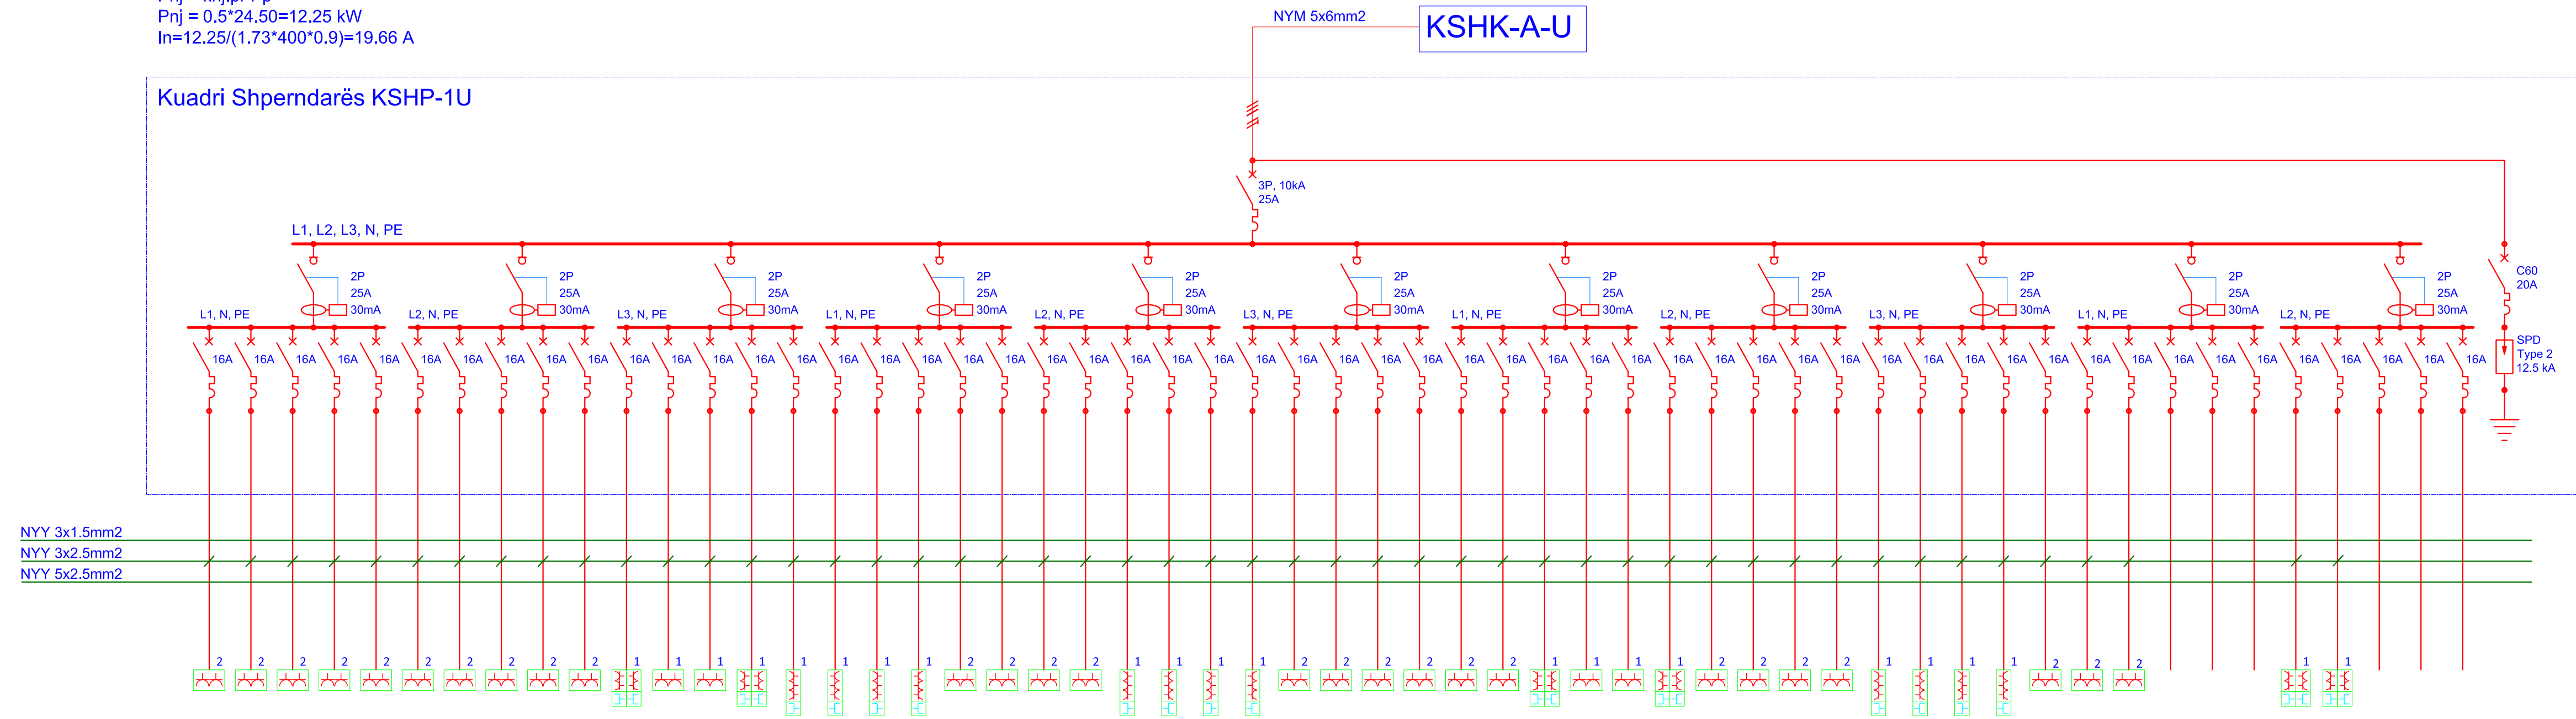

Numri i sigureses	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55			
L1 [kW]	8.50	0.50	0.50	0.50	0.50											0.50	0.50	0.50	0.50	0.50											0.50	0.50	0.50	0.50	0.50									0.50	0.50	Rez.	Rez.	Rez.										
L2 [kW]	8.50					0.50	0.50	0.50	0.50	0.50											0.50	0.50	0.50	0.50	0.50																																	
L3 [kW]	7.50										0.50	0.50	0.50	0.50	0.50																																											
Total [kW]	24.50																																																									

**ELEKTRIKA
SKEMAT NJEPOLARE**

Vërejtjet dhe shënimet shtesë:

Projekti: **OBJEKT AFARIST ADMINISTRATIV**

Investitori: **ALFA sh.p.k**

Projektoi: **Gani Latifi
Kreshnik Boshnjaku**

Kontrollloi: **Vehbi Bresilla**

Niveli i projektit: **PROJEKT KRYESOR**

Vizatimi: **Kuadri Kryesor - Administrata
KSHP-1U**

Perpjese: **Nuk ka**

Nr. i fletes: **ES-09**

Data: **Mars 2015**

Formati: **Long A3**

